

A Novel Approach in Energy and Exergy Investigation of a Thermal Power Plant Boiler

Sugad Singh B¹, Jeyachandran²

¹Department of Electrical and Electronics Engineering, Bethlahem Institute of Engineering

²Department of Electrical and Electronics Engineering, Bethlahem Institute of Engineering

Abstract -This investigative research work utilizes the fundamental concepts of energy and exergy principle to proportionate the energetic and exergetic performance of a gas fired steam power plant boiler in Bangladesh. The installed capacity of the power plant is 210 MW and comprises two-generation unit. The energy and exergy flow in the boiler have been considered in this study. Boiler energy and exergy efficiency have been analyzed as well as total irreversibility in the boiler also determined at different load conditions. Energy efficiency of the boiler is varied from 75% to 80% at different load condition where exergy efficiency is found to be changed from 41.4% to 43% at various load condition. The results from irreversibility analysis show that, exergy destruction increases with the increase of load and maximum for maximum load condition.

Key Words:Power plant, energy flow, exergy, exergy destruction and exergy efficiency

1.INTRODUCTION

Despite the global economic recession, Bangladesh, the country with huge prospects, maintains its sustained GDP growth rate more than 7%. The country needs high electricity growth to meet increased demand in order to supplement national economic growth, as sustainable, social and economic development depends on a country's sufficient power generation. Currently, about 90% of the people have access to electricity and per capita (including captive power) generation in Bangladesh is only 382 kWh. Including captive power and Renewable energy plant, total designed capacity is 20,775 MW [1]. The primary source of fuel is natural gas, which is about 53.9% of total installed capacity in Bangladesh. The government has therefore set a goal to provide everyone with electricity by 2021 and to ensure a reliable and quality electricity supply at a reasonable and affordable price. Majority of the power plant in Bangladesh of steam power plant type, it is essential to operate rigorous investigation to maximize the cycle performance of the power station. The most common method to investigate the performance of power plant is the application of conservation of energy principle. It gives indication about the quantity of energy transforming or processing. However, sometimes the term energy efficiency create misleading information about a system. The problem associated with energy analysis can be redeemed by introducing second law of thermodynamics, which assess the energy quality and introduce new terminology Exergy. In particular, it deals with energy degradation throughout a process, generation of entropy and irreversibility; and it affords ample potential to improve [3]. Irreversibility assessment is considered as a very useful method for optimizing complex

thermodynamic technologies. Many researchers have examined Exergy for various thermal power plants across the world. Rosen [6] assessed the overall performance of coal and nuclear power stations through exergy method. Habib and Zubair [7] carried out a second law investigation in a regenerative Rankine cycle power plants combined with reheating process. Vosough [8] conducted an energy and exergy investigation on a steam power plant boiler and reported that the decrease in excess air from combustion at a fraction of 0.4 to 0.15 will increase energy efficiency and exergy efficiency by 0.19 % and 0.37 % respectively. The author also suggested that, the above-mentioned efficiencies increase to 0.84 % and 2.3 % by reducing the smoke temperature from 137 °C to 90 °C. In terms of developing an optimization strategy, Kabiri et al. [9] examined the energy and exergy of a heat recovery steam generator system in a combined -cycle power plants. Wang et al. [10] analysed exergoeconomic assessment of a coal-fired ultra-supercritical thermal power station in China with the aim of understanding the cost - forming process and evaluating the economic conditions of all subsystems of the plant using SPECO (specific cost of exergy) technique. Medelin et al. [11] submitted an analysis and remodel of power plants providing a coupled analysis of pinch and exergy. This evaluation assesses the total, preventable and inevitable loss of exergy of the system that demonstrates the room for improvement of the equipment. Mousafarash and Ameri [12] addressed the energy, and exergy parameters of the MontazerGhaem gas turbine power plant in the vicinity of Tehran, in order to evaluate the fuel costs of each component. The findings showed that in the combustion zone, the biggest expense of exergy destruction occurs. The combined cycle and Rankine cycle power plants were tested by Kaushik et al. [13] with energy and exergy analysis. This article provides information that the condenser contained the greatest exergy loss and therefore the greatest exergy defect was due to the inadequacy of reasonable combustion and ventilation. Reddy and Alaefour [15] showed interesting data in the assessment of exergy. They presented that the gas turbine combustion chamber generates the greatest exergy in the entire cycle so that the increased pressure ratio in the gas turbine compressor should reduce the loss of exergy in other components. Ameri et al. [16] performed an exergetic investigation on a 420 MW CCGP in Neka, Iran. They evaluated that the gas turbine, combustion chamber, HRSG, and duct burner are the major areas of irreversibility, accounting for 83 % of the power plant's total destruction of exergy. The primary source of destruction of exergy was indeed acknowledged as the gas turbine combustion chamber. Another area of exergy generation was the HRSG, which can decrease the power plant's exergy defect by employing some modification. IsamAljundi [17] carried out an energy and exergy investigation in the power plant of Alhossein in Jordan and deduced that the destruction of exergy in the boiler can be minimized by lowering the fuel air ratio and preheating the air infiltrating in the boiler. Ameri et al. [18] performed an energy

and exergy investigations in Hamedan's steam power plant. The author examined the impact of tweaks in unit load and variations in ambient temperature on overall cycle performance and indicated that preheating the air approaching the boiler leads to an efficiency improvement and it is superior than the power plant usually operates in its marginal load to improve the efficiency. Elsafi [19] carried out an exergy and exergoeconomic assessment on solar power plants for sustainable direct steam production. The author articulated exergy and exergy - expense formulae established on the principle of fuel contents for each element of the plant. Zhai et al.[20] applied the systemic thermo-economic principle assisted with solar energy in a coal-fired power plant. Author described the performance of the plant for both fuel saving and energy increasing approach. They postulated a 15.04 g / kWh reduction for consumption in the fuel-saving approach. In energy increasing approach, the energy output is 57.2 MW higher. They discovered that due to huge investments in solar energy, the thermal economic price of electricity has increased. Li et al. [21] used sub-critical, super-critical, ultra-supercritical steam conditions in power systems to compare energy and exergy. Parikhani et al. [22] carried out an energy, exergy and exergoeconomic investigation on a geothermal plant capacity of 2.33 MW, which is a combination of cooling, and power cycle. They proposed to assess the energy and exergy performance of cogeneration system of the plant. Mitrović et al. [23] portrayed an energy and exergy assessment of a 348.5 MW steam driven power plant in Kostolac in Serbia and observed that the irreversibility in the boiler is greater than the irreversibility in the other modules. Hagi et al. [24] addressed a performance evaluation of oxy coal power plants of the first generation using an exergetic technique for process unification. The capability for process development is pinpointed by the exergy analysis of the plant with limited assimilation and a methodology for heat integration minimizes the destruction of exergy. Rosen and Dincer[25] performed an exergoeconomic analysis of different fuel power plants. The connection between capital costs and thermodynamic deficits has been explored in their work. Gonca [27] reported an energy and exergy investigation for a single and double reheat irreversible Rankine cycle. Author predicted thermal efficiency, exergy destruction, exergy efficiency and net specific work output. Erdem et al. [28] carried out a rigorous energy and exergy performance investigation for nine coal fired thermal power plant. The authors developed a comparison to investigate the inefficiency of the process in the plant and recommended further modification. In their work, they was able to determine the source of main irreversibility's in the system component and indicated necessary remodelling of the plant. Ehyaei et al. [29] researched exergy, environmental and economic evaluation in order to confirm the impacts of the inlet fogging system on the efficiency of first and second law for a conventional gas turbine power plant. This paper is based on the energy and exergy investigation in the boiler of a 210 MW gas fired thermal power plant, which is owned and maintained by Bangladesh Power Development board (BPDB). This article analyzes the energy efficiency and exergy efficiency of the boiler by utilizing the first and second law of thermodynamics. The another objective of this work is to determine the rate of exergy destruction by the boiler in the power plant.

2. POWER PLANT DESCRIPTION

The power plant have been investigated in this work is the oldest power plant in Bangladesh which is known as Chittagong Power Station located 16 miles away from the Chittagong town and north-east side of the city. It is a government own gas fired thermal power plant with an install capacity of 210 MW. The power plant comprises of two steam turbine units, which makes a total capacity of 420 MW at full load condition. The power plant two steam turbine unit (2*210) at 100% load capacity. Operating cycle of this power station is Rankine cycle and an operating flow diagram is presented in Fig. 1. The approximate cycle efficiency of the power plant is 32%. The air-fuel ratio was used in the chamber as 10:1 for full combustion.

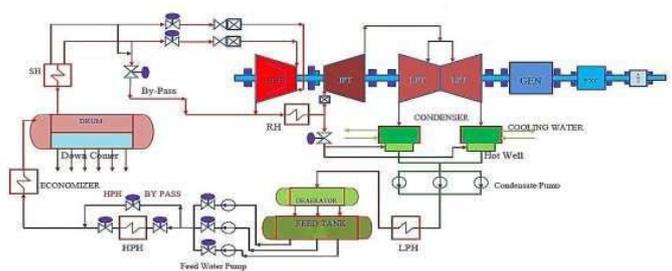


Fig. 1: Process flow diagram of the power plant

3. DATA ANALYSIS AND MODELLING

A. Energy and Exergy Analysis in Boiler

In order to examine energy and exergy in the power plant cycle, the data available in the power plant repository is used to evaluate thermodynamic constraints needed for all cycle points under design conditions. Values of unknown quantities is determined using conservation of energy principle and exergy equations.

Exergy analysis determines maximum available work potential of energy and is determined at a reference ambient condition. For the boiler exergy analysis, it is assumed that the rate of change in exergy is zero. Throughout the combustion of methane in the combustion chamber, methane is used as fuel and the preceding chemical reaction takes place.:

B. Data collection

Mass flow rate, temperature and pressure at different location of the boiler was collected from the archive of the power plant to calculate energy and exergy parameters. Thermodynamics properties of the refrigerant is determined using REFPROP 7 package software. Table 2 shows the collected data from the archive and calculated thermal properties at different load condition

Load	m ₃	m ₄	m _f	T ₁	T ₂	T ₃ (K)	T ₄	P ₁	P ₂	P ₃	P ₄ (MP)
90	39	39	6.	48	4	80	80	12.	12.	12.	12.
10	43	42	7.	48	4	80	80	12.	12.	12.	12.
11	47	47	8.	49	4	80	80	13	13	12.	12.
16	66	66	10	50	5	80	80	13.	13.	12.	12.
17	72	71	12	50	5	80	80	13.	13.	12.	12.
18	74	74	12	51	5	80	80	13.	13.	12.	12.

Table -1: Collected Data

4. RESULT AND DISCUSSIONS

In this study, the energy and exergy efficiency of a steam power station boiler is studied. Energy provided by the fuel and combustion energy efficiency have been studied. Exergy investigation includes exergy destruction and exergy efficiency of the combustor. Data was recorded from the steam power plant and Equations 2-13 have been used to calculate energy and exergy parameters of the boiler. Figure 3 shows the energy efficiency of the boiler at different load condition. Figure shows that, thermal efficiency of the boiler is different at different load condition and thermal efficiency is maximum for a 160 MW load condition. The designed energy efficiency of the boiler is 87.16%. The variation in exergy gain by steam at different load condition is demonstrated in Figure 4. Exergy gain by steam is increasing with the increase of load as at different load condition mass flow of the steam is different. Figure 5 shows the exergy supplied by the fuel at different load conditions.

Energy and exergy of boiler in a 420 MW steam power at Bangladesh have been studied. Energy efficiency, exergy efficiency, exergy gain, exergy destruction at different load condition has been reported. From the above findings, the following conclusions can be drawn: The overall energy efficiencies vary from 75% to 80% and exergy efficiencies varies from 41.4 % to 43 % for boiler. Energy efficiency and exergy efficiency reached at a maximum value during the load of 160 MW. Exergy destruction rate in boiler is maximum during the load 180 MW. Exergy destruction rate is higher for higher load condition.

REFERENCES

[1] (2018) BPDB. Present Installed Generation Capacity (MW) [Online]. Available at: http://www.bpdb.gov.bd/bpdb_new/index.php/site/page/13e9-2cc0-ce41-9c09-088d-94d5-f546-04a6-b4fa-1d18.

[2] Ahmadi GR, Toghraie D. "Energy and exergy analysis of Montazeri Steam Power Plant in Iran," *Renew Sustain Energy Rev*, vol. 56, pp. 454–63, 2016.

[3] Cengel Y., Boles M. *Thermodynamics: An Engineering Approach*. 5th ed. New York: McGraw-Hill Education; 2006.

[4] Utlu Z, Hepbasli A. A review on analyzing and evaluating the energy utilization efficiency of countries. *Renew Sustain Energy Rev*, Vol. 11, pp. 1–29, 2007.

[5] Wall G. "Exergy flows in industrial processes," *Energy*, vol. 13, pp. 197–208, 1988. [6] Rosen MA. "Energy- and exergy-based comparison of coal-fired and nuclear steam power plants," *Exergy, An Int J*, vol. 1:pp. 180–92, 2001.

[6] Rosen MA. "Energy- and exergy-based comparison of coal-fired and nuclear steam power plants," *Exergy, An Int J*, vol. 1:pp. 180–92, 2001.

[7] Habib MA, Zubair S. "Second-law-based thermodynamic analysis of regenerative-reheat Rankine-cycle power plants," *Energy*, vol. 17: pp. 295–301, 1992.

[8] Amir V. "Improving Steam Power Plant Efficiency through Exergy Analysis: Ambient Temperature," In: 2nd Int. Conf. Mech. Prod. Automob. Eng., p. 209–12; 2012.

[9] Kaviri AG, Jaafar MNM, Lazim TM, Barzegaravval H. "Exergoenvironmental optimization of Heat Recovery Steam Generators in combined cycle power plant through energy and exergy analysis," *Energy Convers Manag*, vol. 67, pp 27–33, 2013.

[10] Wang L, Yang Y, Dong C, Xu G, Wu L. "Exergoeconomic Evaluation of a Modern Ultra-Supercritical Power Plant," *Energies*, vol. 5, pp 3381–97, 2012.

[11] Medellin AA, Papayanopoulos EM, Millares CR. "Diagnosis and redesign of power plants using combined Pinch and Exergy Analysis," *Energy*, vol. 72, pp 643–51, 2014.

[12] Mousafarash A, Ameri M. "Exergy and exergo-economic based analysis of a gas turbine power generation system," *J Power Technol*, vol. 93, pp 44–51, 2013.

[13] Kaushik SC, Reddy VS, Tyagi SK. "Energy and exergy analyses of thermal power plants: A review," *Renew Sustain Energy Rev*, vol. 15:1857–72, 2011.

[14] Regulagadda P, Dincer I, Naterer GF. "Exergy analysis of a thermal power plant with measured boiler and turbine losses," *ApplThermEng*, vol. 30, pp 970–6, 2010.

[15] Reddy B, AlaefourIE. "Performance simulation of a natural gas fired combined cycle power generation system," In: 19th Natl. 8th ISHMT–ASME heat mass Transf. Conf., pp. 305–9; 2008.

[16] Ameri M, Ahmadi P, Khanmohammadi S. "Exergy analysis of a 420 MW combined cycle power plant," *Int J Energy Res*, vol. 32, pp 175–83, 2008.

[17] Aljundi IH. "Energy and exergy analysis of a steam power plant in Jordan," *ApplThermEng*, vol. 29, pp 324–8, 2009.

[18] Ameri M, Ahmadi P, Hamidi A. "Energy, exergy and exergoeconomic analysis of a steam power plant: A case study," *Int J Energy*, vol. 33, pp 499–512, 2009.

[19] Elsafi AM. "Exergy and exergoeconomic analysis of sustainable direct steam generation solar power plants," *ENERGY Convers Manag*, vol.103, pp 338–47, 2015.

[20] Zhai R, Liu H, Li C, Zhao M, Yang Y. "Analysis of a solar-aided coal- fi red power generation system based on thermo-economic structural theory," *Energy*, vol. 102, pp 375–87, 2016.

[21] Li Z, Li Z, Yan Z. "Energy and Exergy Analysis for Three Type 500MW Steam Power Plants," *ApplMech Mater Vols*, vol. 149, pp 1131–6, 2012.

[22] Parikhani T, Ghaebi H, Rostamzadeh H. "A novel geothermal combined cooling and power cycle based on the absorption power cycle: Energy, exergy and exergoeconomic analysis," *Energy* 2018

[23] Mitrovic D, Zivkovic D, Lakovic M. "Energy and Exergy Analysis of a 348 . 5 MW Steam Power Plant," Energy Sources, Part A, vol. 32, pp 1016–27, 2010.

[24] Hagi H, Le Y, Nemer M, Bouallou C. "Performance assessment of first generation oxy-coal power plants through an exergy-based process integration methodology," Energy, vol. 69, pp 272–84, 2014.

[25] Rosen MA, Dincer I. "Exergoeconomic analysis of power plants operating on various fuels," ApplThermEng, vol. 23, pp 643–58, 2203.

[26] Khaliq A. "Exergy analysis of gas turbine trigeneration system for combined production of power heat and refrigeration," Int J Refrig, vol. 32, pp 534–45, 2009.

[27] Gonca G. "Energy and exergy analyses of single and double reheat irreversible Rankine cycle GuvenGonc," Int J Exergy, vol. 18, pp 402–22, 2015.

[28] Erdem H, Akkaya A, Cetin B, Dagdas A, Sevilgen S, Sahin B, et al. "Comparative energetic and exergetic performance analyses for coal-fired thermal power plants in Turkey," Int J ThermSci, vol. 48, pp 2179–86, 2009.

[29] Ehyaei MA, Mozafari A, Alibiglou MH. "Exergy, economic & environmental (3E) analysis of inlet fogging for gas turbine power plant," Energy, vol. 36, pp 6851–61, 2011.

[30] Dincer I, Cengel Y. Energy, Entropy and Exergy Concepts and Their Roles in Thermal Engineering. 2001. [31] Reistad G. "Available energy conversion and utilization in the United State," ASME Trans J Eng Power, vol. 97, pp 429–34. 1975.