

Transformer Health Monitoring System by using Internet of Things (IOT)

C. S. Parkhi¹, Vinay N. Duryodhan², Sahil V. Chitade², Yashit S. Ghadse², Pranay P. Kichak²

¹Assistant Professor, Electrical Engineering Department, Rajiv Gandhi College of Engineering, Research & Technology, Chandrapur

²Students of Electrical Engineering Department, Rajiv Gandhi College of Engineering, Research & Technology, Chandrapur

Abstract –Transformer is one of the important electrical equipment that is used everywhere. Monitoring transformer's health had become a fiery task. Since incase of any damaged in the internal properties of the transformer will result in huge drawback. So, it is mandatory to regularly keep an eye of the transformer. The main objective of this proposal is to acquire live data of transformer health remotely over the internet using Internet of Things (IOT) technology. We are going to monitor the transformer parameter such as temperature, current and voltage. The transformer will be having a problem such as increasing in temperature and make a lot of noise. Typical transformer measurement system will take time for testing and less accurate. The aim of this project is to design the IoT system for monitoring and evaluate the performance of the transformer current, sound and temperature. The Arduino microcontroller is used by the system to collect data and send it to a cloud-based server. A variety of sensors are used to gather vital indicators of transformer health, such as temperature, oil level, and current. A web-based interface is used to evaluate and visualize the gathered data, giving remote access to the transformer's status. In order to improve the longevity and dependability of power distribution networks, this Internet of Things (IoT)-based monitoring system provides an economical and effective means of proactive maintenance and early identification of any defects in distribution transformers

1. INTRODUCTION

The distribution transformer is electrical equipment in power system which distributes power to the users directly, and its operating condition is important to the distribution network operators. The operation of distribution transformers underrated condition guarantees their long life. However, their life is significantly reduced if they are subjected to overloading, resulting in unexpected failures and loss of supply to a large number of customers thus effecting power system reliability.

The key causes of a transformer's health degradation are problems such as overburdening and insufficient heating. Gathering data from transformer is very important to monitor and control the entire of the transformer in efficiently and reliably. The health and safe operation of transformer in electrical distribution is important due to unexpected fault that will occur. Therefore, transformer health monitoring and accurate fault diagnosis are beneficial in reducing equipment harm economic loss and impacts on the reliability of electric power systems. The transformer monitoring for problem before may help avoid expensive repairs and a reduction in service life. This method allows to track the transformer's health on a regular basis and take the appropriate steps to ensure that it is properly maintained.

Wireless monitoring system by using Internet of Things (IoT) has been around for a while and mostly used in industry to track key performance from remote locations. It provides useful information about the health of the distribution transformer and will facilitate the services of the transformer and increase the lifetime of a transformer. The output data is stored in a database after processing so that the report can be viewed using mobile applications. As a result, an online measurement device is used to collect and analyse various types of data from sensors over time.

2. EXISTING SYSTEM

Manual monitoring of transformer conditions, such as temperature rise, load current, oil level, and voltage, can be complex and lacks insights into critical issues like occasional overloads or overheating of the oil and temperature. To address this, an IoT-based system has been proposed. This system collects key operational data from transformers, helping utility companies optimize their performance and extend their lifespan.

By identifying problems early, the system prevents minor issues from escalating into major ones, ultimately enhancing transformer durability. It works by comparing

real-time data with the transformer's rated values. If any monitored parameters exceed the acceptable limits, the Arduino in the system is programmed to take preventive measures. Additionally, it displays the collected data on a remote computer, making it easier to monitor and respond effectively.

2.1 Demerits of Existing System

- It is purely based on SMS services. It doesn't include android application (Mobile App).
- Practically at some points this system could not work efficiently. Since SMS will be based on carrier charge and continues monitoring is made impossible.
- Making cost is too expensive.
- Since SMS service is used it doesn't provide live tracking because SMS will have some latency on reception.
- If you want to make the latency minimum service provider will charge extra amount for it.
- There is no point of contact with consumer in the system.
- As a result, the consumer will not get any knowledge about the power failure or system maintenance.
- It doesn't include the feature of Phase prevention which is any of phase fails there is no indication.

3. PROPOSED SYSTEM

3.1 Merits of Proposed System

- It is purely based on SMS along with MQTT services.
- It includes android Mobile application
- Practically at every point this system could work efficiently. Since along with SMS.
- MQTT also used so continues monitoring is made possible.
- Cost effective.
- Since MQTT service is used it provides live tracking.
- There is common point of contact with consumer in the system.

- As a result, the consumer will get any knowledge about the power failure or system maintenance.
- It includes the feature of Phase prevention which is any of phase fails there is no indication.

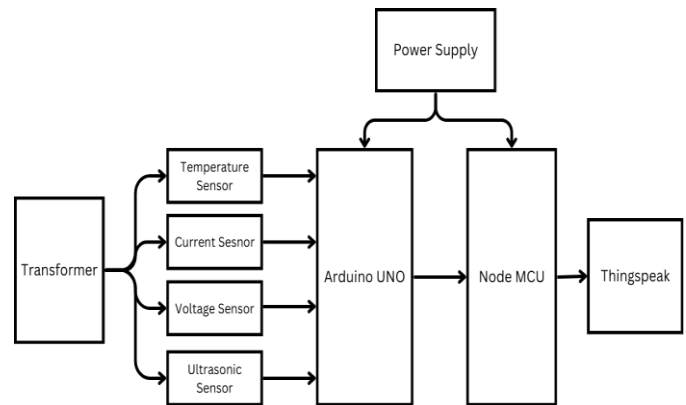


Figure 1. Block Diagram of the Proposed System

3.2 METHODOLOGY

3.2.1 Cloud Server

In this system, the ThingSpeak platform is utilized for data analytics and processing. ThingSpeak collects data from devices in the form of compact messages using the HTTP protocol over the Internet. It offers real-time visualization of the uploaded data, along with features like location tracking and integration with social media platforms. Additionally, ThingSpeak provides a MATLAB tool for advanced data analysis, either through the cloud or via a dedicated all-in-one server. In the proposed system, data is transmitted to ThingSpeak at intervals of 15 seconds, with a payload size of 3000 bytes per transmission.

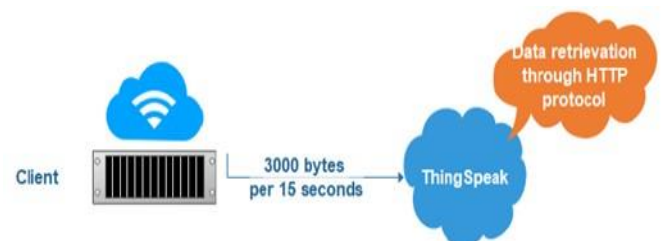


Figure 2. Block Diagram of the Proposed System

3.2.2 Workflow of the Proposed System

Workflow of system is completed in following steps:

- a) Collect sensor-based data
- b) Deploy data to cloud and data visualization
- c) Develop health index algorithm

3.3 WORKING

This technology is designed for online parameter monitoring of distribution transformers, enabling utilities to maximize the efficiency of their transformers and extend their operational lifespan. The system employs four key sensors: a temperature sensor, a voltage sensor, a current sensor, and a level sensor. These sensors are powered alongside the Arduino UNO and Wi-Fi modem using a dedicated power source. Data captured by the sensors is transmitted via the Wi-Fi module to the user at a specified IP address, as per the programmed configuration. The readings are also displayed on an LCD screen. By detecting anomalies or insecure data, the system allows for timely preventive actions to avoid transformer failures.

4. HARDWARE COMPONENTS

The project is designed to emit a reduced size and maximum efficiency. The components used are Arduino, temperature sensor, current sensor, voltage sensor circuit and Node MCU.

4.1 TEMPERATURE SENSOR-LM 35

Temperature sensor is used to sense the current temperature status of a transformer or generator. It has three pins as shown in fig 4. The output obtained from the temperature sensor is proportionally dependent on the temperature in degree Celsius sensed. The operating temperature ranges from -55°C to 150°C . It draws about 60 micro amperes from the supply and has reduced self-heating. It does not tend to possess a temperature rise more than 0.1°C in still air. For every $^{\circ}\text{C}$ rise or fall in temperature the output response will be 10mV variation. This LM35 operates from 4V to 30V . It has $+1/4^{\circ}\text{C}$ of typical nonlinearity. Pin description is as shown in the table.1.

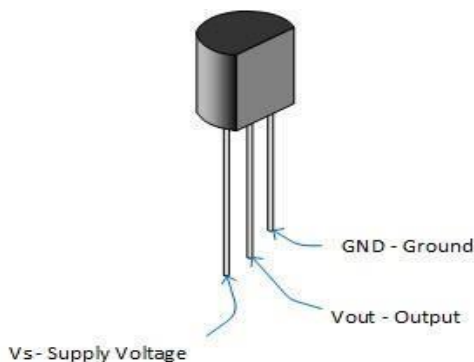


Figure 3. LM 35 Temperature Sensor

Table 1. Pin description of temperature sensor LM-35

Pin no	Pin name	Description
1	Vcc	Input supply voltage: +5V
2	Analog output Voltage	Usually, +6 V to -1 V.
3	Ground	Ground: 0V

4.2 CURRENT SENSOR

ACS712 current sensor produces an analog output voltage proportional to the current sensed by the terminals. The current sensor can operate from an voltage of 5V . Even high AC mains current can be measured. The sensors are based on the Allegro ACS712ELC chip. These sensors are available full scale reading of 5A , 20A and 30A . For a 30A sensor the output sensitivity is 66mV/A and it can measure a current from 30mA -to- 30A range.

ACS712 consists of a low offset, precise linear Hall effect sensor circuit having a copper conduction path around the die surface. The hall effect circuit convert the electromagnetic field produced during current flow through the copper part to output voltage.

4.3 VOLTAGE SENSOR



Figure 4. Voltage Measurement Circuit

It is a combination of $1\text{N}4007$ diode, a step-down transformer, variable resistor $47\text{K}\Omega$, capacitor $1\mu\text{F}$ 25V , 5V Zennor diode. Usually, 5V output is obtained during 250V . variable resistance is adjusted to get the output. $\text{AC Voltage} = (230/1024) * \text{ADC_Value}$

4.4 ULTRASONIC SENSOR HC-SR04

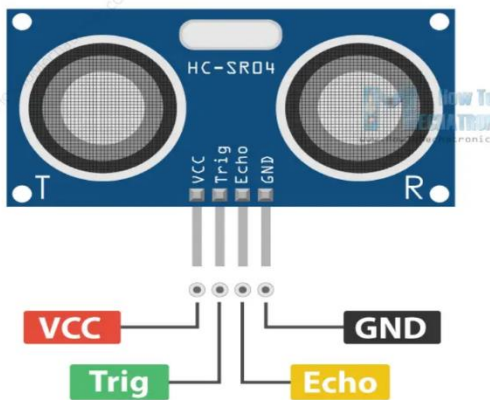


Figure 5. Ultrasonic Sensor HC-SR04

Ultrasonic sensors are based on the principle of sound waves, which are emitted by a transducer and then reflected when they encounter an obstacle. These reflected waves are then detected by the sensor and used to determine the distance and direction of the obstacle. The frequency range of ultrasonic sensors typically falls between 20 kHz and 200 kHz.

4.5 NODE MCU V3

Node MCU is an open source IoT platform. It includes firmware which runs on the ESP8266 Wi-Fi SoC from Espressif Systems, and hardware which is based on the ESP-12 module. This is a single board microcontroller. The operating system is XTOS. This is version 3 and it is based on ESP-12E. Multiple GPIO pins on the board allow us to connect the board with other peripherals and are capable of generating PWM, I2C, SPI, and UART serial communications. USB to UART converter is added on the module that helps in converting USB data to UART data which mainly understands the language of serial communication. Instead of the regular USB port, Micro USB port is included in the module that connects it with the computer for programming and powering up the board as shown in fig 5. LED blinks giving the current status of the module if it is running properly when connected with the computer. The power voltage for USB be kept around 5 V. It has a memory of about 128kBytes. Storage is about 4Mbytes.

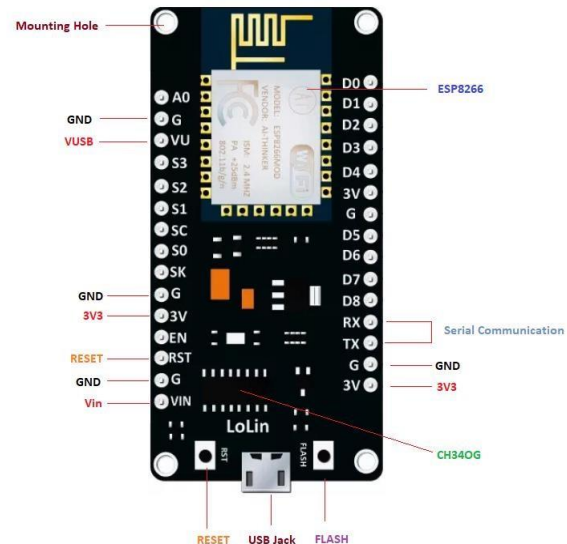


Figure 6. Node MCU v3

The Arduino nano and Node MCU exchange data through serial communication. The Node MCU will be treated as master and Arduino nano act as slave during this communication. Arduino acts according to the instructions given by Node MCU.

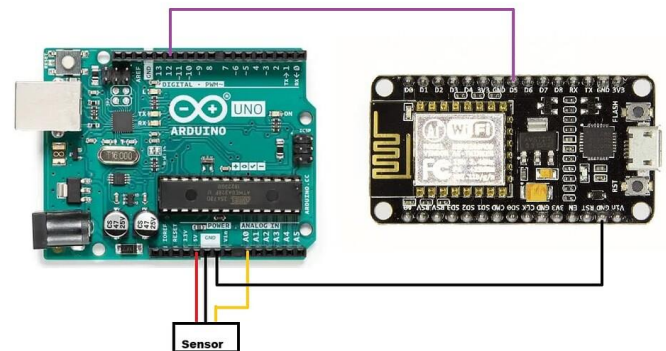


Figure 7. Interconnection of Arduino Nano and Node MCU

4.6 ARDUINIO UNO

Arduino UNO is a microcontroller board based on the ATmega328P. It has 14 digital input/output pins (of which 6 can be used as PWM outputs), 6 analog inputs, a 16 MHz ceramic resonator, a USB connection, a power jack, an ICSP header and a reset button.



Figure 8. Arduino UNO

4.6.1 Specification of Arduino UNO

Category	Specification
Name	Arduino UNO R3
SKU	A000066
Microcontroller	ATmega328P
USB Connector	USB-B
Pins	
Built-in LED Pin	13
Digital I/O Pins	14
Analog Input Pins	6
PWM Pins	6
Communication	
UART	Yes
I2C	Yes
SPI	Yes
Power	
I/O Voltage	5V
Input Voltage (Nominal)	7-12V
DC Current per I/O Pin	20 mA
Power Supply Connector	Barrel Plug
Clock Speed	
Main Processor	ATmega328P 16 MHz
USB-Serial Processor	ATmega16U2 16 MHz
Memory	
ATmega328P	2KB SRAM, 32KB FLASH, 1KB EEPROM
Dimensions	
Weight	25 g
Width	53.4 mm
Length	68.6 mm

5. ADVANTAGES

- Easy to use.
- Remote monitoring using IOT.
- No men power required.
- Construction wise it is easy and simple.
- It required less space.
- Its maintenance is negligible.
- This system is economical and save the time for data collection.
- As it monitors the transformer the life of transformer increases.
- It reduces costs on testing.
- It is portable as its size is compact.

6. LIMITATIONS

- Complex Hardware.
- One system required for one transformer.

7. CONCLUSION

The proposed system not only the increase the reliability and stability but also save the time of maintenance of the transformer, energy and also reduce the effort. With the help of the kit, we can not only monitor the transformer condition but also collect the data so that we can manufacture the transformer in such a way that fault condition can be reduced. Another advantage of the kit is that we can monitor the transformer condition from remote location also, so no need to visit the site on regular interval. If we increase the sensor the some more reading also collected form the transformer. By using this type of monitoring system, it increases the life of transformer.

8. REFERENCES

- R. a. D. S. Pawar, "Health condition monitoring system for distribution transformer using internet of things (IoT)," in International Conference on Computing Methodologies And Communication (ICCMC), 2017.
- Techopedia, "techopedia," [Online]. Available: www.techopedia.com/definition/28247/internet-of-things-iot. [Accessed 30 October 2018].
- AEMO, "About the industry," [Online]. Available: www.aemo.com.au/aboutaemo/about-the-industry. [Accessed 2 March 2019].
- M. M. a. S. Ballal, "Online condition monitoring system for substation and service transformer," IET Electric Power Applications, vol. 11, no. 7, pp. 1187-1195, 2017.
- M. a. S. Wang, "Review of condition assessment of power transformer in service," IEEE Electrical Insulation Magazine, vol. 18, no. 6, pp. 12-25, 2002.
- A. a. B. Zargari, "Acoustic detection of partial discharges using non-intrusive optical fiber sensors," in IEEE 6th International Conference On Conduction And Breakdown In Solid Dielectrics, 1998.
- F. Systems, "www.flir.com/power-distribution," [Online]. Available: www.flir.com/powerdistribution. [Accessed 10 March 2019].
- E. C. a. F. Mackenzie, "Online-monitoring and diagnostics for power transformers," IEEE International Symposium On Electrical Insulation, pp. 1-5, 2010.
- IEC Standards 60076 Power Transformer– all parts.
- IS standards 2026 transformers.
- S.S. Basu "Transformers BHEL" 6th Edition 1994, Tata McGraw-Hill Publication.
- Electrical measurement and measuring instrument by A. K. Sawhney.
- Lin Zairong (SEARI). Simple method for fast routine testing the Dynamic ratio error of current or potential transformer and its instrument. pp 228-231.
- B. L. Theraja Electrical Machines Vol. 2 3rd Edition 2010, S. Chand publication.
- Vishwanath R, Akshatha V Shetty, Poonam, Shamilli And M Thanuja, "A New Approach to monitor Condition of Transformers incipient fault diagnosis based on GSM & XBEE", International Journal of Science, Engineering and Technology Research (IJSETR), Vol. 4(11),pp. 3826-3829,2015.
- Monika Agrawal And Akshay Pandya, "GSM Based Condition Monitoring of Transformer", IJSRD - International Journal for Scientific Research & Development| Vol. 1, Issue 12, 2014 | ISSN (online): 2321-0613.